



\* DIMENSIONS MAY VARY.  
CONSULT PLANS TO VERIFY WIDTH  
OF R.O.W. AND SIDEWALK

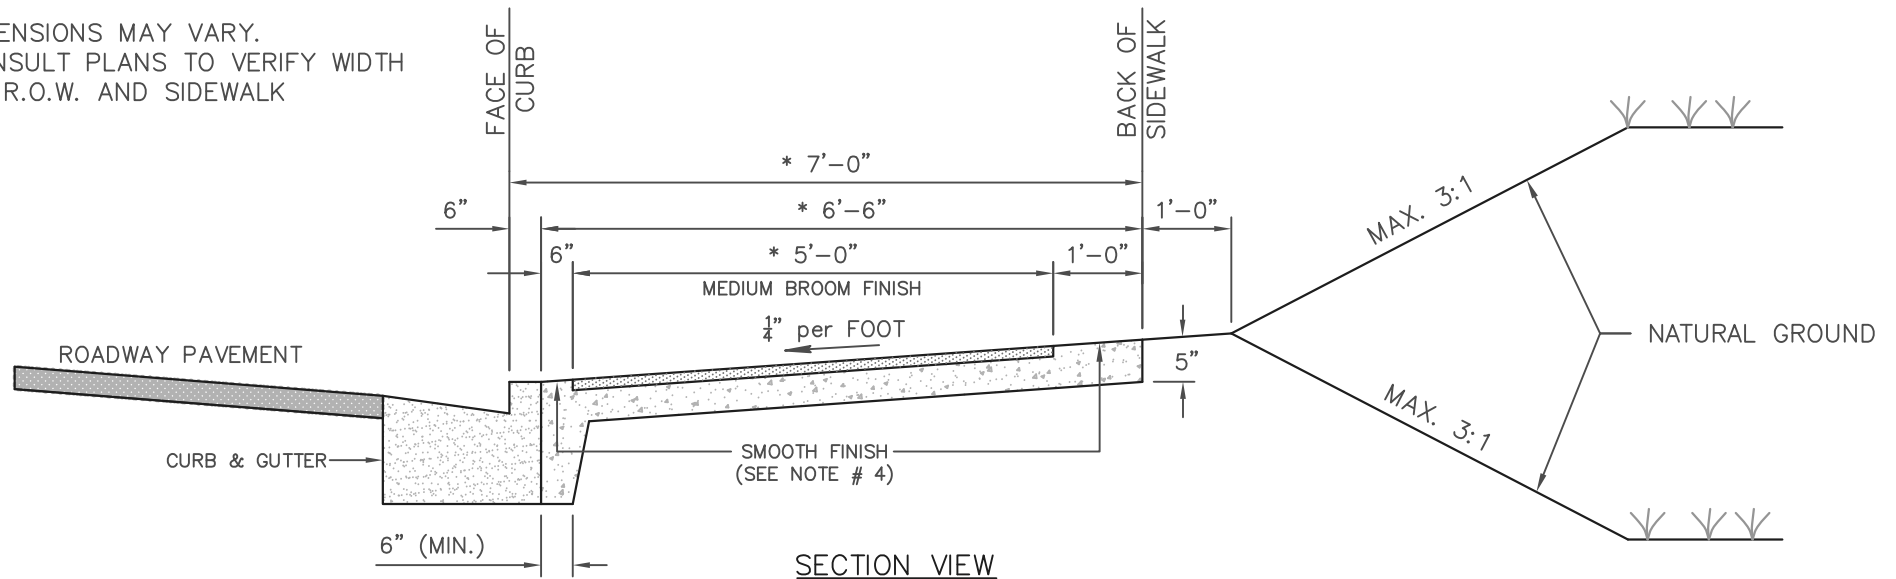

SECTION VIEW

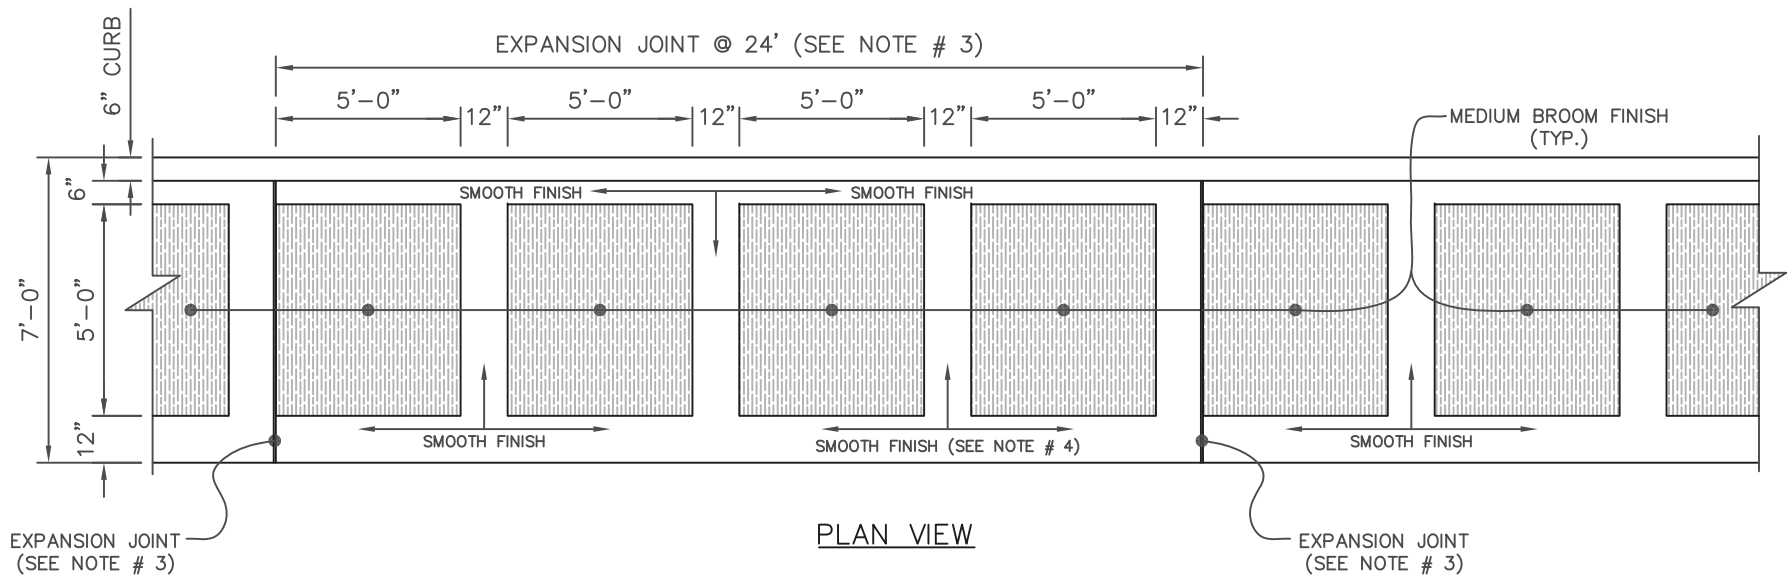

PLAN VIEW

NOTES:

1. UNLESS OTHERWISE NOTED ON PLANS, CONCRETE SHALL BE CLASS A, 3500 PSI READY MIX TYPE CONFORMING TO ASTM SPECIFICATION C94 AND COMPOSED OF PORTLAND CEMENT, SAND, AND WASHED COURSE LIMESTONE AGGREGATE. AIR-ENTRAINMENT SHALL BE 5%, ( $\pm 2\%$ ).
2. ALL MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE CITY OF GERMANTOWN STANDARD SPECIFICATIONS AND AS SET FORTH IN THE CITY'S SIDEWALK ORDINANCE.
3. EXPANSION JOINTS SHALL BE INSTALLED EVERY TWENTY-FOUR (24') FEET (MAX.).
4. THE SMOOTH BAND FINISH AROUND THE PERIMETER OF THE BROOM FINISHED AREAS SHALL BE A SMOOTH, STEEL TROWEL FINISH.
5. THE MAXIMUM SIDEWALK CROSS SLOPE SHALL BE 2%.



ENGINEERING DEPARTMENT

SIDEWALK - OLD GERMANTOWN

DRAWN: MLC  
CHECKED: JDB  
APPROVED: EWS

DATE: 08.04.23  
REVISED: \_\_\_\_\_  
SCALE: NTS