


* DIMENSIONS MAY VARY.
CONSULT PLANS TO VERIFY WIDTH
OF R.O.W. AND SIDEWALK

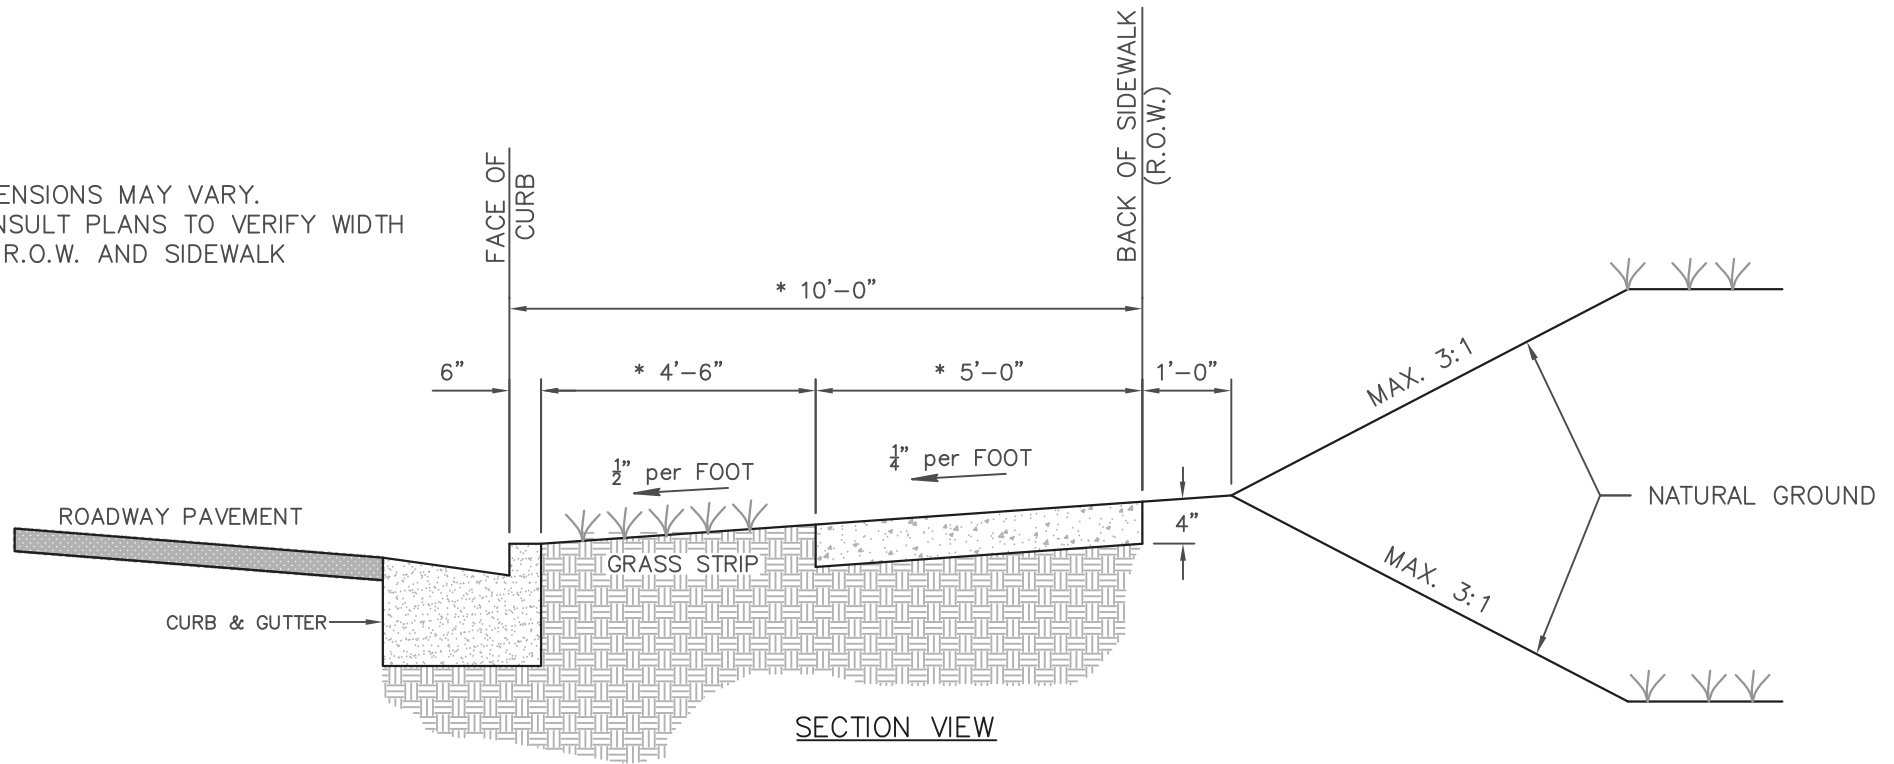

SECTION VIEW

SIDEWALK – RESIDENTIAL

NOTES:

1. UNLESS OTHERWISE NOTED ON PLANS, CONCRETE SHALL BE CLASS A, 3500 PSI READY MIX TYPE CONFORMING TO ASTM SPECIFICATION C94 AND COMPOSED OF PORTLAND CEMENT, SAND, AND WASHED COURSE LIMESTONE AGGREGATE. AIR-ENTRAINMENT SHALL BE 5%, ($\pm 2\%$).
2. ALL MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE CITY OF GERMANTOWN STANDARD SPECIFICATIONS AND AS SET FORTH IN THE CITY'S SIDEWALK ORDINANCE.
3. 4FT SIDEWALK – EXPANSION JOINTS SHALL BE INSTALLED EVERY TWENTY-FOUR (24') FEET (MAX.).
5FT SIDEWALK – EXPANSION JOINTS SHALL BE INSTALLED EVERY TWENTY-FIVE (25') FEET (MAX.).
4. RESIDENTIAL STYLE SIDEWALKS SHALL HAVE A BROOM FINISH. THE MAXIMUM SIDEWALK CROSS SLOPE SHALL BE 2%.



ENGINEERING DEPARTMENT

SIDEWALK – RESIDENTIAL

DRAWN: <u>MLC</u>	DATE: <u>08.04.23</u>
CHECKED: <u>JDB</u>	REVISED: _____
APPROVED: <u>EWS</u>	SCALE: <u>NTS</u>